


DWG. NO. **IDL P6600FA07WM** REV. **1**

LTR	REVISION	BY	DATE	APPR
1	ADDED MASTER RELAYS	RRY	8/24/99	RRY

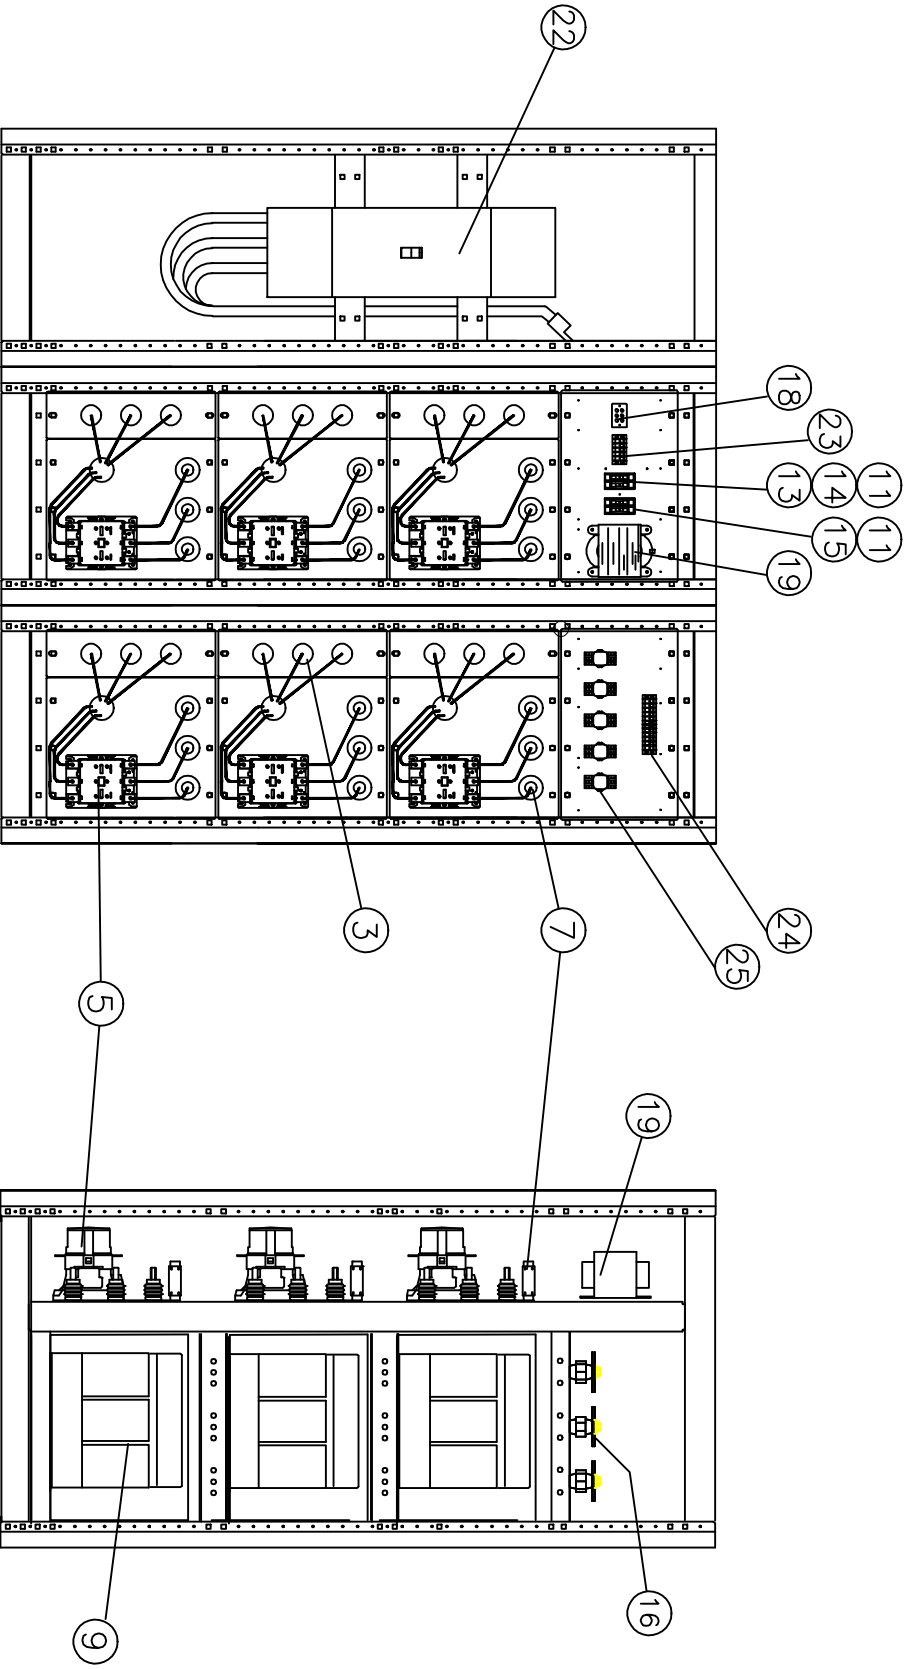

TYPICAL 600 KVAR UNIT

TOL'S UNLESS OTHERWISE SPEC.
 .000 ±
 .00 ±
 FRACTIONAL ±
 ANGULAR ± 0°30'

DRAWN BY RRY	DATE 4/14/07
CHECKED BY RRY	DATE 4/14/07
APPROVED BY RRY	DATE 4/14/07
CAD SYS. NO. INTERNAL	

TITLE:
INTERNAL ASSEMBLY

SCALE
NONE

SHEET **1** OF **1**

A

GE/ULtravqr™
 Power Factor Correction Business Unit
 381 Broadway, Fort Edward, New York 12828 USA

DWG. NO. **IDL P6600FA07WM S/N 3176**

REV. **1**

DISTR. TO