


SIZE	DWG NO	SHT	REV
A		1	0
REV	DESCRIPTION	DATE	APPROVED
0			

KVAR	2400 VOLTS		
	CAT. NO.	A (IN.)	B (IN.)
25	ICC1025U33L	-	27.68
50	ICC1050U33	-	27.68
75	ICC1075U33	-	27.68
100	ICC1100U33	-	29.44
125	ICC1125U33	0.75	30.18
150	ICC1150U33	0.50	32.68
175	ICC1175U33	0.17	33.35
200	ICC1200U33	0.17	33.35
225	ICC1225U33	0.88	36.06
250	ICC1250U33	0.88	36.06
275	ICC1275U33	0.12	39.06

KVAR	4160 VOLTS		
	CAT. NO.	A (IN.)	B (IN.)
25	ICC1025L33L	-	27.68
50	ICC1050L33	-	27.68
75	ICC1075L33	-	27.68
100	ICC1100L33	-	29.44
125	ICC1125L33	0.75	30.18
150	ICC1150L33	0.50	32.68
175	ICC1175L33	0.17	33.35
200	ICC1200L33	0.17	33.35
225	ICC1225L33	0.88	36.06
250	ICC1250L33	0.88	36.06
275	ICC1275L33	0.12	39.06

KVAR	4800 VOLTS		
	CAT. NO.	A (IN.)	B (IN.)
25	ICC1025M33L	-	27.68
50	ICC1050M33	-	27.68
75	ICC1075M33	-	27.68
100	ICC1100M33	-	29.44
125	ICC1125M33	0.75	30.18
150	ICC1150M33	0.50	32.68
175	ICC1175M33	0.17	33.35
200	ICC1200M33	0.17	33.35
225	ICC1225M33	0.88	36.06
250	ICC1250M33	0.88	36.06
275	ICC1275M33	0.12	39.06
300	ICC1300M33	0.12	39.06

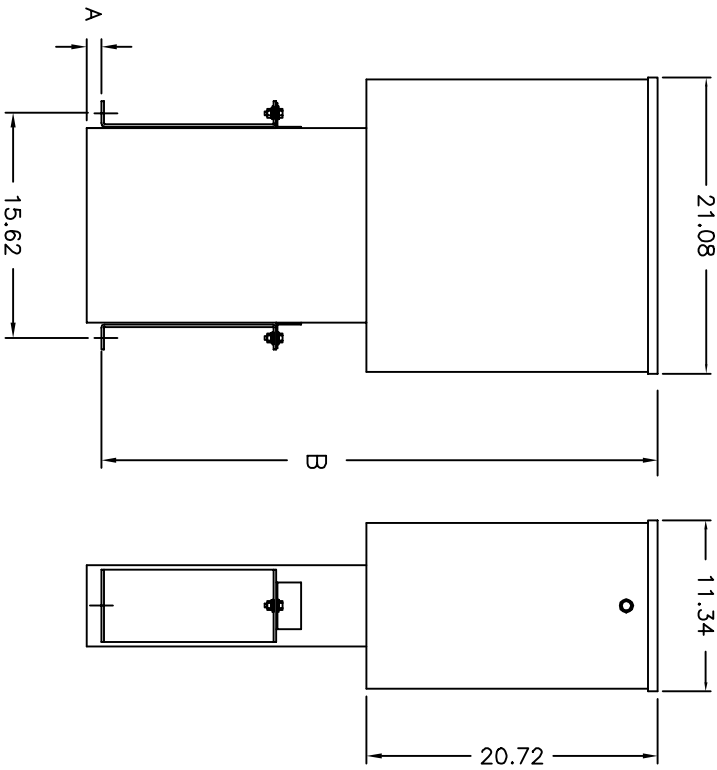

- NOTES:
- EXTERNAL 120VAC POWER SOURCE REQUIRED
  - BRACKET MOUNTING HOLES ARE .50X.62 SLOTS
  - CAPACITOR MAY BE WALL OR CEILING MOUNTED WITH BRACKETS BY OTHERS.
  - FUSE INTERRUPT RATING 50 KAIC
  - THREE PHASE FUSING AVAILABLE AS OPTION
  - INDOOR/OUTDOOR GASKETED WIRING HOOD
  - FINISH ANSI 70 GRAY

		POWER FACTOR CORRECTION FORT EDWARD, N.Y., U.S.A.	
DRAWN B.ROSS	DATE JUN 3, 2003	SCALE A	SHEET 1
ISSUED	DATE	OUTLINE ICC1	CONT -