


SIZE A	DWG NO	SHT 1	REV 1
REV 1	DESCRIPTION A WAS B	DATE 4/13/05	APPROVED

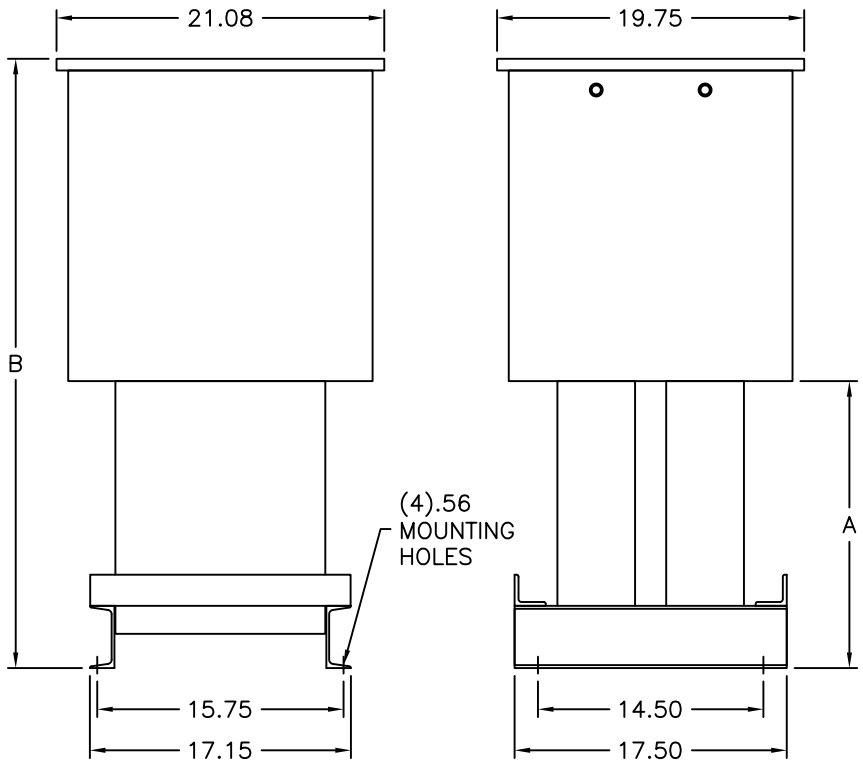

KVAR	2400 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
300	ICC2300J33L	12.70	33.43	149
325	ICC2325J33L	12.70	33.43	154
350	ICC2350J33L	12.70	33.43	159
375	ICC2375J33L	12.70	33.43	165
400	ICC2400J33L	12.70	33.43	171
425	ICC2425J33L	18.45	39.18	181
450	ICC2450J33L	18.45	39.18	192
475	ICC2475J33L	18.45	39.18	192
500	ICC2500J33L	18.45	39.18	192
525	ICC2525J33L	18.45	39.18	203
550	ICC2550J33L	18.45	39.18	214

KVAR	4160 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
325	ICC2325L33L	12.70	33.43	154
350	ICC2350L33L	12.70	33.43	159
375	ICC2375L33L	12.70	33.43	165
400	ICC2400L33L	12.70	33.43	171
425	ICC2425L33L	18.45	39.18	181
450	ICC2450L33L	18.45	39.18	192
475	ICC2475L33L	18.45	39.18	192
500	ICC2500L33L	18.45	39.18	192
525	ICC2525L33L	18.45	39.18	203
550	ICC2550L33L	18.45	39.18	214
575	ICC2575L33L	18.45	39.18	214
600	ICC2600L33L	18.45	39.18	214

KVAR	4800 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
325	ICC2325M33L	12.70	33.43	154
350	ICC2350M33L	12.70	33.43	159
375	ICC2375M33L	12.70	33.43	165
400	ICC2400M33L	12.70	33.43	171
425	ICC2425M33L	18.45	39.18	181
450	ICC2450M33L	18.45	39.18	192
475	ICC2475M33L	18.45	39.18	192
500	ICC2500M33L	18.45	39.18	192
525	ICC2525M33L	18.45	39.18	203
550	ICC2550M33L	18.45	39.18	214
575	ICC2575M33L	18.45	39.18	214
600	ICC2600M33L	18.45	39.18	214

- NOTES:
- EXTERNAL 120VAC POWER SOURCE REQUIRED
 - FRAME MOUNTING HOLES ARE .56" DIAMETER
 - FRAME MAY BE MOUNTED ON FLOOR, WALL, OR CEILING
 - FUSE INTERRUPT RATING 50 KAIC
 - THREE PHASE FUSING AVAILABLE AS OPTION
 - INDOOR/OUTDOOR GASKETED WIRING HOOD
 - FINISH ANSI 70 GRAY

	POWER FACTOR CORRECTION FORT EDWARD, N.Y., U.S.A.		SIZE A	<p style="text-align: center;">OUTLINE ICC2</p>
	DRAWN B.ROSS	DATE APR 13, 2005	SCALE	
ISSUED	DATE			

DISTR. TO