


SIZE A	DWG NO	SHT 1	REV 1
REV 1	DESCRIPTION A WAS B	DATE 4/13/05	APPROVED

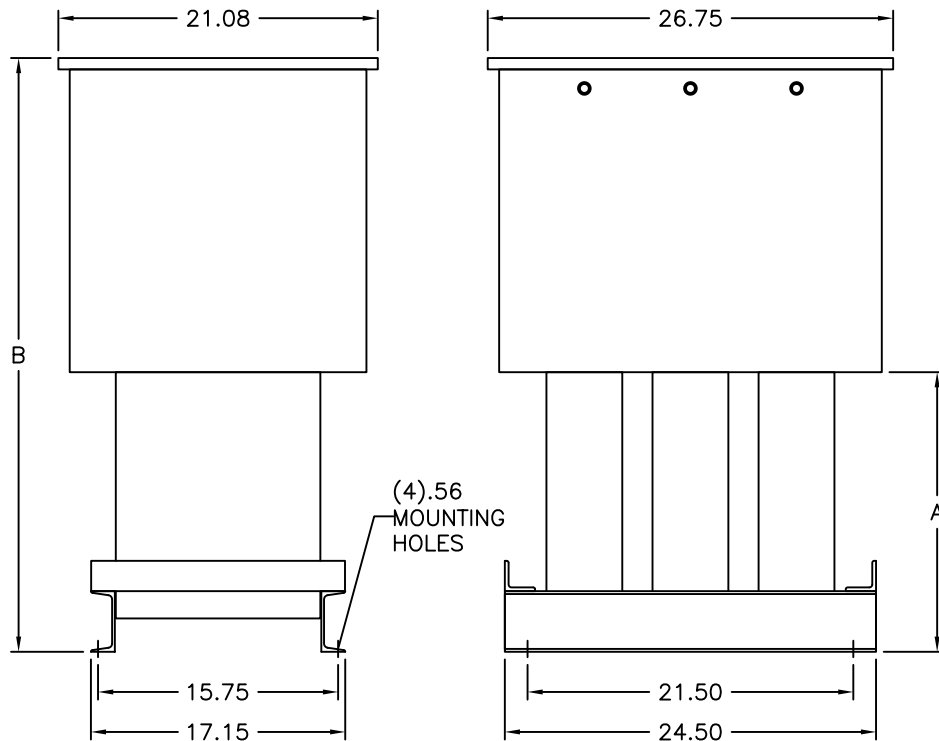

KVAR	2400 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
575	ICC3575J33L	12.70	33.43	248
600	ICC3600J33L	12.70	33.43	254
625	ICC3625J33L	18.45	39.18	265
650	ICC3650J33L	18.45	39.18	276
675	ICC3675J33L	18.45	39.18	287
700	ICC3700J33L	18.45	39.18	298
725	ICC3725J33L	18.45	39.18	298
750	ICC3750J33L	18.45	39.18	298
775	ICC3775J33L	18.45	39.18	309
800	ICC3800J33L	18.45	39.18	320
825	ICC3825J33L	18.45	39.18	331

KVAR	4160 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
625	ICC3625L33L	18.45	39.18	265
650	ICC3650L33L	18.45	39.18	276
675	ICC3675L33L	18.45	39.18	287
700	ICC3700L33L	18.45	39.18	298
725	ICC3725L33L	18.45	39.18	298
750	ICC3750L33L	18.45	39.18	298
775	ICC3775L33L	18.45	39.18	309
800	ICC3800L33L	18.45	39.18	320
825	ICC3825L33L	18.45	39.18	331
850	ICC3850L33L	18.45	39.18	331
875	ICC3875L33L	18.45	39.18	331
900	ICC3900L33L	18.45	39.18	331

KVAR	4800 VOLTS			
	CAT. NO.	A (IN.)	B (IN.)	WT (LBS)
625	ICC3625M33L	18.45	39.18	265
650	ICC3650M33L	18.45	39.18	276
675	ICC3675M33L	18.45	39.18	287
700	ICC3700M33L	18.45	39.18	298
725	ICC3725M33L	18.45	39.18	298
750	ICC3750M33L	18.45	39.18	298
775	ICC3775M33L	18.45	39.18	309
800	ICC3800M33L	18.45	39.18	320
825	ICC3825M33L	18.45	39.18	331
850	ICC3850M33L	18.45	39.18	331
875	ICC3875M33L	18.45	39.18	331
900	ICC3900M33L	18.45	39.18	331

NOTES:

- EXTERNAL 120VAC POWER SOURCE REQUIRED
- FRAME MOUNTING HOLES ARE .56" DIAMETER
- FRAME MAY BE MOUNTED ON FLOOR, WALL, OR CEILING
- FUSE INTERRUPT RATING 50 KAIC
- THREE PHASE FUSING AVAILABLE AS OPTION
- INDOOR/OUTDOOR GASKETED WIRING HOOD
- FINISH ANSI 70 GRAY

	POWER FACTOR CORRECTION FORT EDWARD, N.Y., U.S.A.		SIZE A	<p style="text-align: center;">OUTLINE ICC3</p>
	DRAWN B.ROSS	DATE APR 13, 2005	SCALE	
ISSUED	DATE			

DISTR. TO